


CUSTOMER MUST CALL 811 FOR AN UNDERGROUND SERVICE ALERT 48 HOURS BEFORE YOU DIG OR INSTALL GROUND ROD(S)



IMPORTANT NOTICE
Section 4216/4217 of the Government Code requires a Dig Alert Identification Number to be issued before a "Permit to Excavate" will be valid. For your Dig Alert I.D. Number call **CALL TOLL FREE 48 HOURS BEFORE YOU DIG UNDERGROUND SERVICE ALERT CALL 811**

THE CUSTOMER IS RESPONSIBLE FOR THE INSTALLATION AND MAINTENANCE OF THE FOLLOWING:
SERVICE PANEL
SERVICE PANEL GROUNDING/BONDING
MAINTAINING TREE CLEARANCE
CITY OF BANNING ELECTRIC UTILITY IS RESPONSIBLE FOR THE INSTALLATION AND MAINTENANCE OF THE FOLLOWING:
THE UNDERGROUND SERVICE CONDUCTOR & ELECTRIC METER

GROUNDING CONDUCTOR SIZING:
100A SERVICE: #8 SOLID COPPER GROUND/BONDING
125A SERVICE: #8 SOLID COPPER GROUND/BONDING
200/225A SERVICE: #4 SOLID COPPER GROUND/BONDING

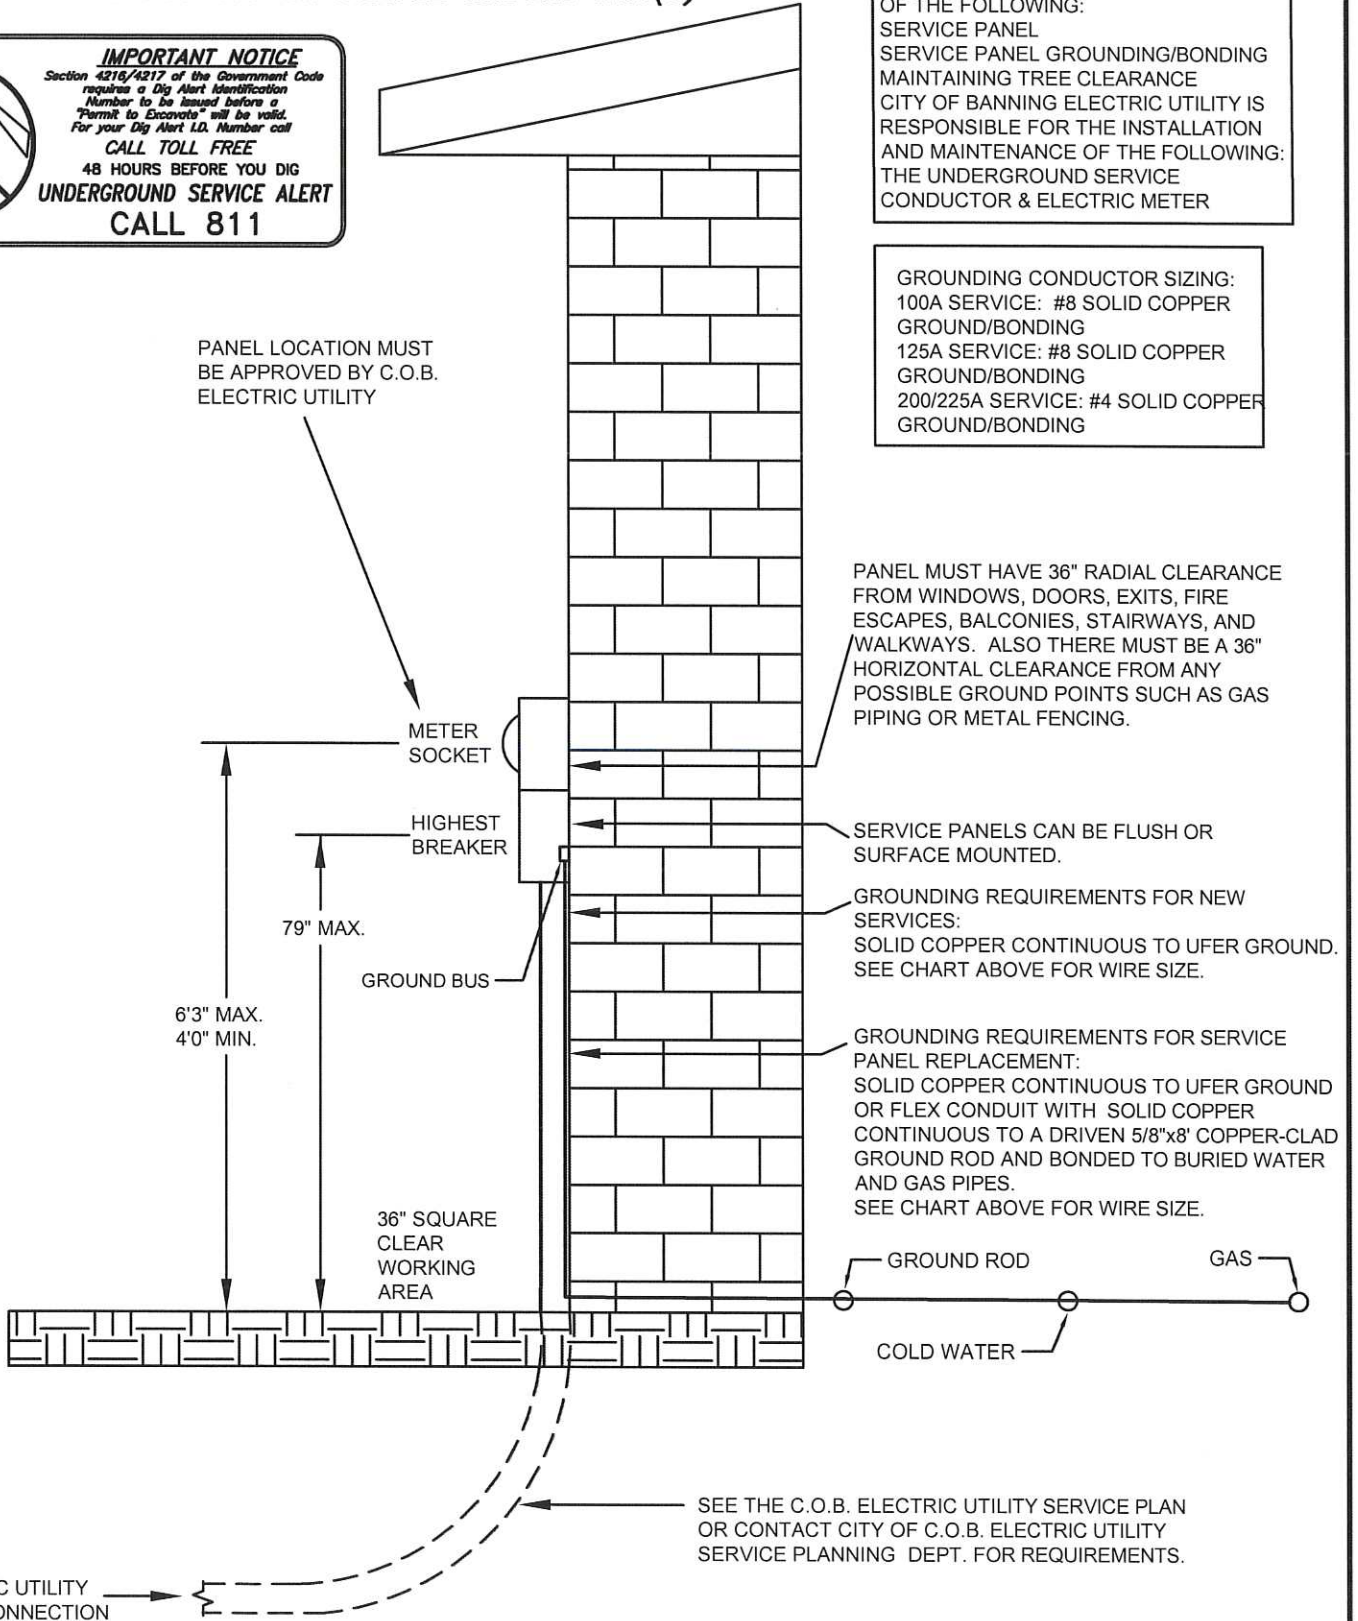

Proud History
Prosperous Tomorrow

REVISED: 04/08/2020

APPROVED: *[Signature]*

STANDARD DRAWINGS

TYPICAL UNDERGROUND SERVICE

SD

600-09