


THIS STANDARD SHOWS THE WARNING LABEL REQUIREMENTS FOR THE PV SERVICE PANEL



NOTES:

- A. REQUIRED PLACARDS SHALL BE ATTACHED TO THE ELECTRIC EQUIPMENT WITHOUT COVERING MANUFACTURER LABELING OR LOCATED ADJACENT TO THE IDENTIFIED EQUIPMENT (PER AHJ APPROVAL)
  - 1. ALL PLACARDS SHALL BE OF SUFFICIENT DURABILITY TO WITHSTAND THE ENVIRONMENT.
  - 2. ALL PLACARDS SHALL BE PERMANENTLY ATTACHED TO THE SURFACE OF THE ELECTRICAL EQUIPMENT BY MEANS OF EPOXY OR EQUIVALENT SUITABLE FOR THE ENVIRONMENT (SCREWS OR RIVETS ARE NOT ALLOWED)
  - 3. ALL PLACARDS SHALL BE EITHER METAL OR PLASTIC WITH ENGRAVED OR MACHINE PRINTED LETTERS OR ELECTRO-PHOTO PLATING IN RED WITH WHITE LETTERING.
  - 4. ALL PLACARDS SHALL NOT BE SMALLER THAN 2"x5" AND NO LARGER THAN 3"x6" (WITH THE EXCEPTION OF THE DIRECTORY PLACARD)
  - 5. ALL PLACARDS FONT STYLE SHALL BE ARIAL WITH THE FONT SIZE NO SMALLER THAN SIZE 12 OR NO LARGER THAN SIZE 28.

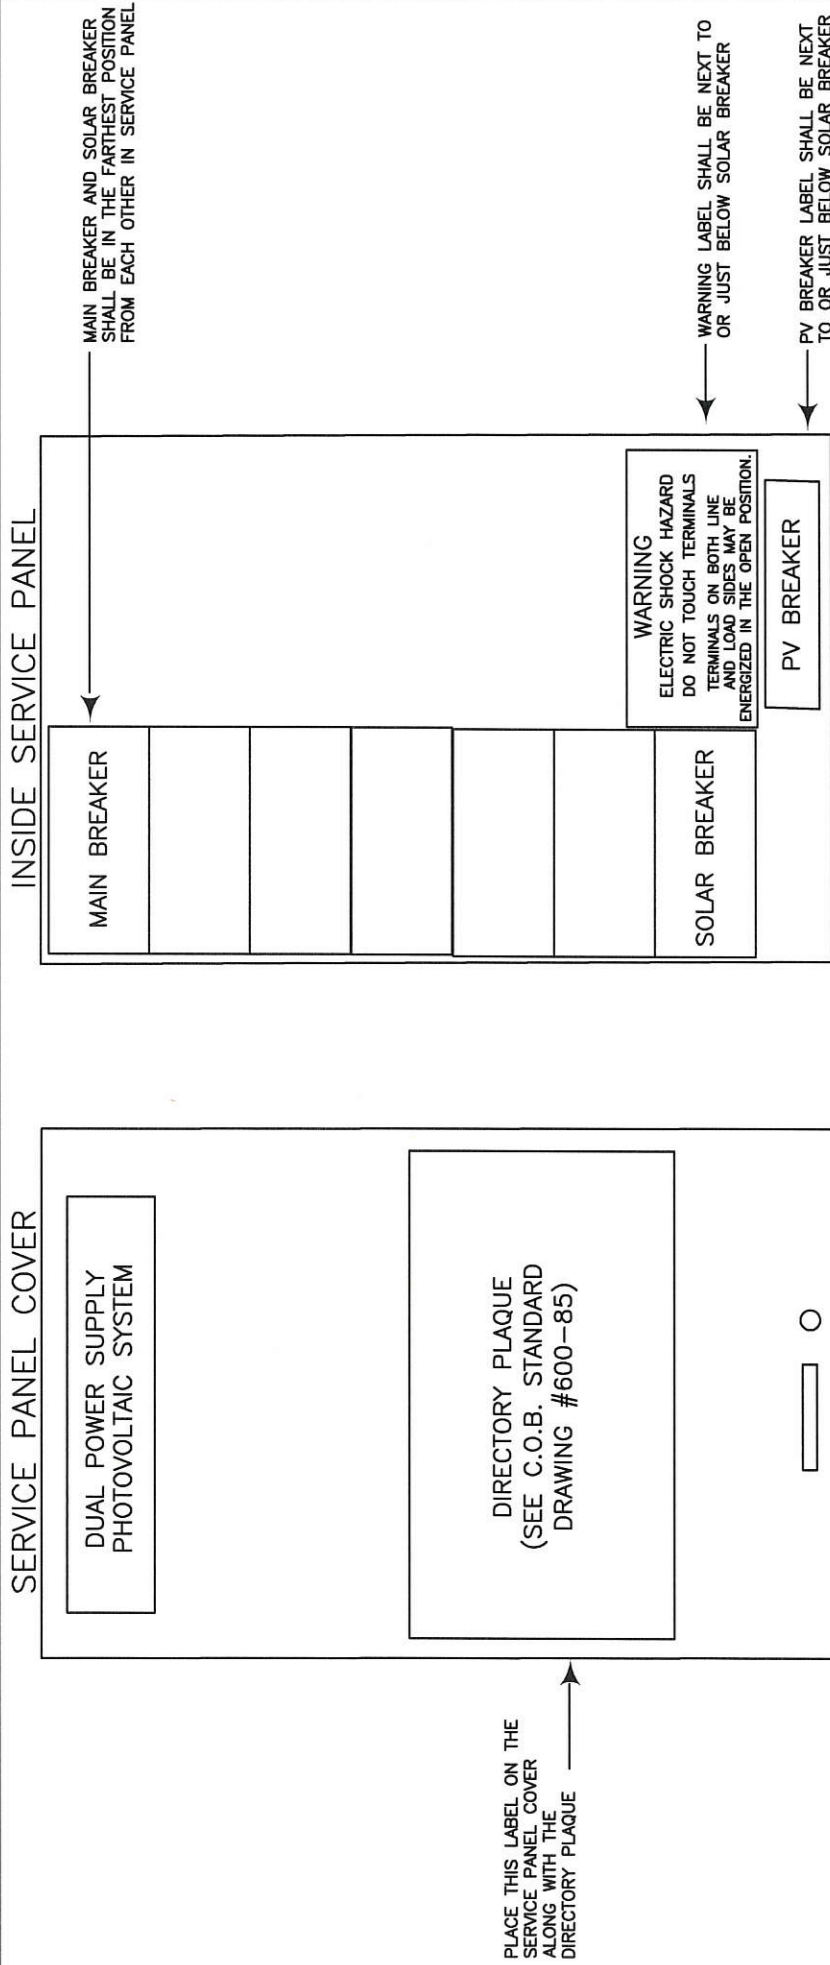

REVISED: 03/22/2018

APPROVED: *Bradley* 7/19/18

STANDARD DRAWINGS

PV SERVICE PANEL WARNING LABELS

**SD**

600-84